



Controller & Indicator





Overview of Process Controllers

What is a Controller?

A Controller is a device that is used to control an equipment by comparing a process signal with a set point and performing calculations according to the deviation between those values. Devices that can handle process signals such as Temperature, Humidity, Pressure and Flow Rate are called Controllers.

ON/OFF Controller

Types of
Process
Controllers

PID Controller


Difference between ON/OFF and PID Controller

- PID Controller can provide output in both the form, Analog and Digital, whereas an ON/OFF controller provides output in digital form only
- ON/OFF Controllers are used in applications where some deviation can be accepted without hampering the process., whereas PID Controllers are used in applications where a very less amount of deviation is accepted
- In ON-OFF control method process can not be stable at set-point and the PID controller can adjust its output to match the power that is required to keep the process stable at the setpoint
- PID Controllers are costlier than ON/OFF Controllers, due to more features that they provide and the precision with which PID controllers operates



Overview of Controllers

Controller Configuration of a Feedback Control System

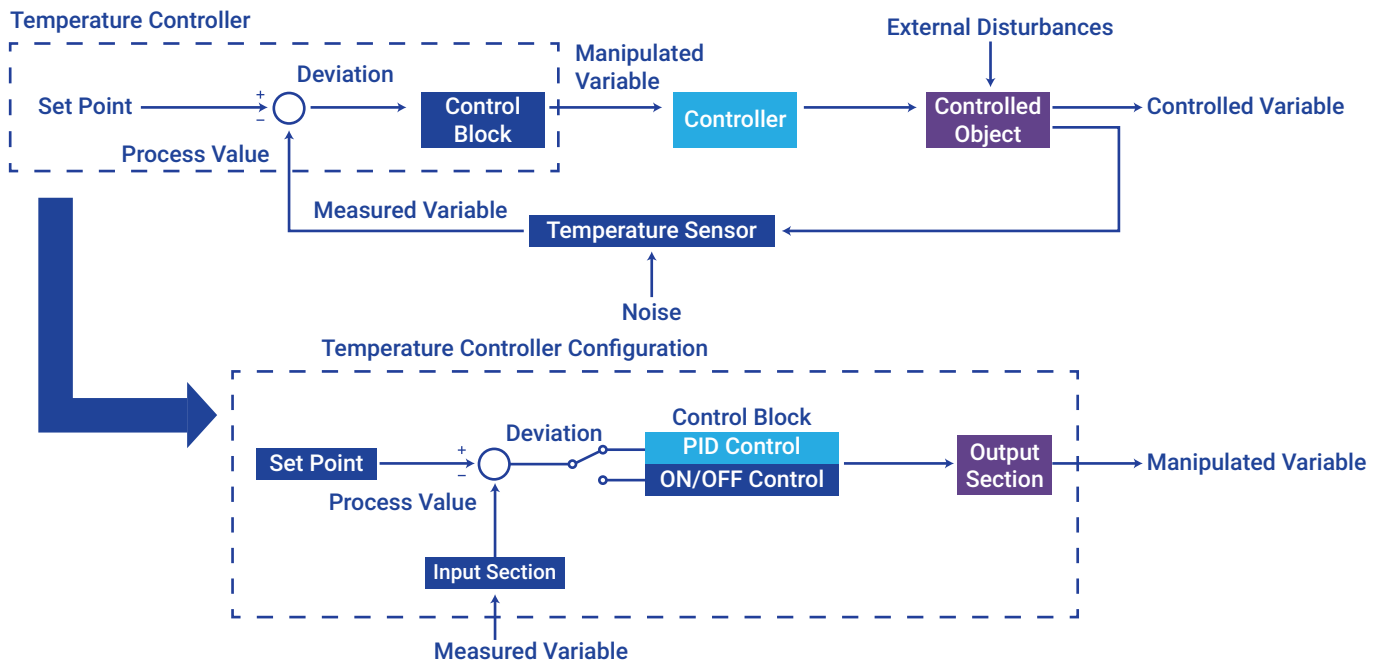


Control Methods

What is ON/OFF Control Action?

ON/OFF Controller is the simplest form of temperature control device. The output from the device is either ON or OFF, with no middle state. An ON/OFF Controller will switch the output only when the temperature crosses the set point.


For ex.: For heating control, the output is ON when the temp. is below the set point, and OFF above set point.

Characteristics of ON/OFF Control Action

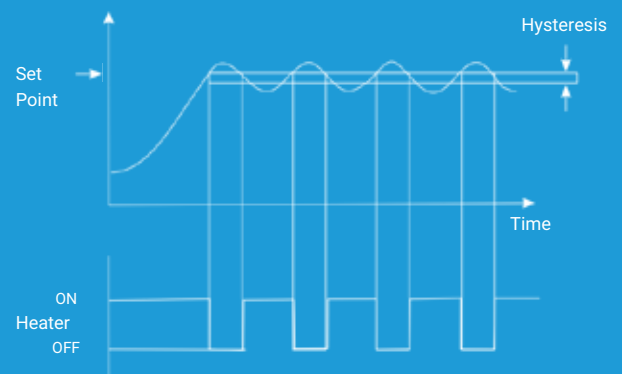

What is PID Control Action?

A PID Controller is an instrument used by control engineers to regulate temperature, flow, pressure, speed and other process variables in industrial control systems. PID controllers use a control loop feedback mechanism to control process variables and are the most accurate and stable controller.

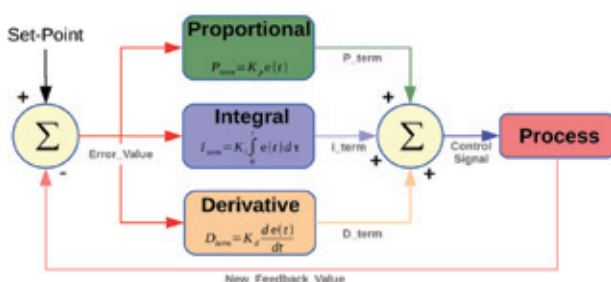

PID control is a well-established way of driving a system towards a target position or control parameters. It's practically ubiquitous as a means of controlling temperature and finds application in a myriad of chemical and scientific processes as well as automation. PID control keeps the actual output from a process as close to the target or setpoint output as possible.




Overview of Controllers


PID Controller Working Principle

The working principle behind a PID Controller is that the proportional (“P”), integral (“I”), and derivative (“D”) terms must be individually adjusted or ‘tuned’. Based on the difference between these values a correction factor is calculated and applied to the input.

For example: If an oven is cooler than required, the heat will be increased.

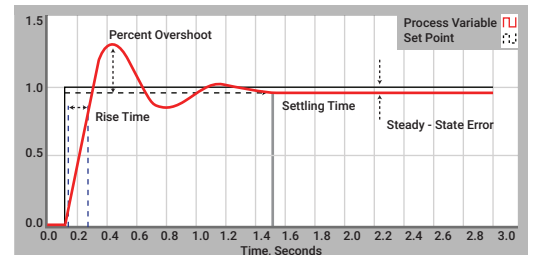

Here are the three steps

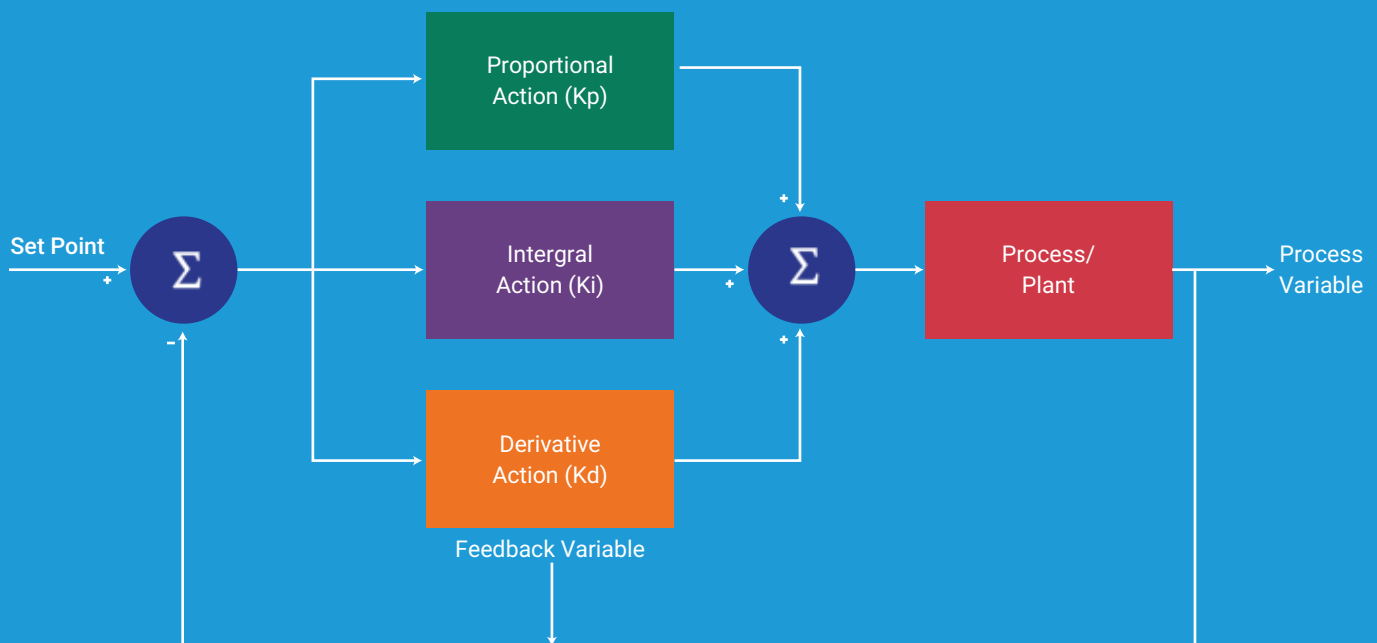

- **Proportional Tuning** involves correcting a target proportional to the difference. Thus, the target value is never achieved because as the difference approaches zero, so does the applied correction
- **Integral Tuning** attempts to remedy this by effectively cumulating the error result from the “P” action to increase the correction factor. **For example:** If the oven remained below temperature, “I” would act to increase the heat delivered. However, rather than stop heating when target is reached, “I” attempts to drive the cumulative error to zero, resulting in an overshoot
- **Derivative Tuning** attempts to minimize this overshoot by slowing the correction factor applied as the target is approached.



Controllers Offerings



TC5396



TC5348



TC548E



5040



5002U-P



5006-RN



LC5296-DC



LC5296-XP-DC



LC5296-XP-AT



Experience: 45+ years of experience in designing controllers

Fail Safe: Designed to go in safe mode when process fails



Knowledge: Backed by vast application knowledge for Industries

Communication: Easy to manage and interface with PLC, SCADA and IIoT



Configurable: Input & output signal type is configurable, helps reduce inventory

Service: Rugged, Reliable & Repeatable Controller with 10 years service support





Technical Specifications- Controllers

		5040	5002U-P	LC5296-XP-AT	LC5296-DC
					
Mounting		Panel	Panel	Wall	Panel
Panel Cut Out (HXW)		92.5 x 92.5	92.5 x 92.5		92.5 x 92.5
Dimension (HXWXD)		96 x 96 x 110	96 x 96 x 110	340 x 186 x 110	96 x 96 x 75
Character Height	PV	0.56"	0.56"	0.56"/ 0.8"	0.56"
	SV	0.4"	0.4"	0.4"/0.56"	0.56"
Accuracy	TC, RTD	± 0.1% of F.S ± 1 °C	TC (E,J,K,T,C,J,N,C,G), RTD: ± 0.1% of F.S ± 1 °C	±0.25% of FS ±1 count	±0.25% of FS ±1 count
	TC (B,R,S)		: ± 0.2% of F.S ± 1 °C		
Input	Current, Voltage	± 0.1% of F.S ± 1 count	± 0.1% of F.S ± 1 count	± 0.1% of F.S ± 1 cour	± 0.1% of F.S ± 1 count
	Process Value Input	Thermocouple (E, J, K, T, B, R, S, N) RTD (Pt100), Current, Voltage	Thermocouple (E, J, K, T, B, R, S, N,C,G) RTD (Pt 100), Current, Voltage	Thermocouple (E, J, K, T, B, R, S), RTD (Pt100), Current, Voltage	Thermocouple (E, J, K, T, B, R, S), RTD (Pt100), Current, Voltage
Control Output	Remote Setpoint Input	4 to 20 mA, 0-20mA, 0-5V, 1-5V	X	X	X
	ZV Input	Potentiometer 100 to 2K Ohm	X	X	X
Output	Digital Input	4	X	X	X
	Relay	●	●	●	●
Control Method	SSR	●	X	●	X
	Linear	●	X	●	X
Communication	Motorized Valve	●	X	●	X
	Re-transmission Output	Upto 2*	Upto 2*	Upto 2*	Upto 2*
Power Supply	Alarm	Upto 4 *	3	Upto 2*	Upto 2*
	Digital Output	4	X	X	X
Communication	LPS	●	●	●	●
	ON/OFF	●	●	●	●
Power Supply	PID	●	X	●	X
	RS-485	●	●	●	●
Power Supply	85-265 VAC / 100-300 VDC	●	●	●	●
	18-36 VDC	●	●	●	●

* For more details, refer Product Catalogue

LC5296-XP-DC	5006RN	TC5396	TC548E	TC5348	LC5296H
					
Wall	Panel	Panel	Panel	Panel	Panel
	92.5 x 92.5	92 x 92	45 x 45	45 x 45	45 x 92
340 x 186 x 110	96 x 96 x 75	100 x 100 x 55	50 x 50 x 74	50 x 50 x 98	48 x 96 x 85
0.56" / 0.8"	0.56"	0.8"	0.4"	0.4"	0.56" / 0.8"
0.4"/0.56"	X	0.56"	0.31"	0.28"	X
±0.25% of FS ±1 count	±0.25% of FS ±1 count	±0.25% of FS ±1 count	±0.25% of FS ±1 count	±0.25% of FS ±1 count	±0.25% of FS ±1 count
± 0.1% of F.S ± 1 count	± 0.1% of F.S ± 1 count	± 0.1% of F.S ± 1 count		± 0.1% of F.S ± 1 count	± 0.1% of F.S ± 1 count
Thermocouple (E, J, K, T, B, R, S), RTD (Pt100), Current, Voltage	Thermocouple (J, K, T, R, S), RTD (Pt100), Current, Voltage	Thermocouple (E, J, K, T, B, R, S), RTD (Pt100), Current, Voltage	Thermocouple (E, J, K, T, B, R, S), RTD (Pt100)	Thermocouple (E, J, K, T, B, R, S), RTD (Pt100), Current, Voltage	Thermocouple (J, K, T, R, S), RTD (Pt100), Current, Voltage
X	X	X	X	X	X
X	X		X	X	X
X		X	X	X	X
●	●	●	●	●	●
X	X	●	●	●	X
X	X	●	X	●	X
X	X	●	X	●	X
Upto 2*	Upto 2*	Upto 2*	X	Upto 2*	Upto 2*
Upto 2*	2	Upto 4*	Upto 2*	Upto 2*	2
X	X	X	X	X	X
●	●	●	X	X	●
●	●	●	●	●	●
X	X	●	●	●	X
●	●	●	X	●	●
●	●	●	●	●	●
●	●	●	●	●	●



PID Controllers


5040 Single Loop PID Controller



5040

- User friendly menu driven hardware and software configuration
- Truly universal Input / Output including valve positioner
- One model for all applications, reduces inventory
- Field proven for critical Ratio/Cascade applications
 - Right fit for combustion control
- Favourite page selection for frequently used parameter
- 4 Digital input and 4 digital output options available

Pulp Consistency Control- Paper Industries

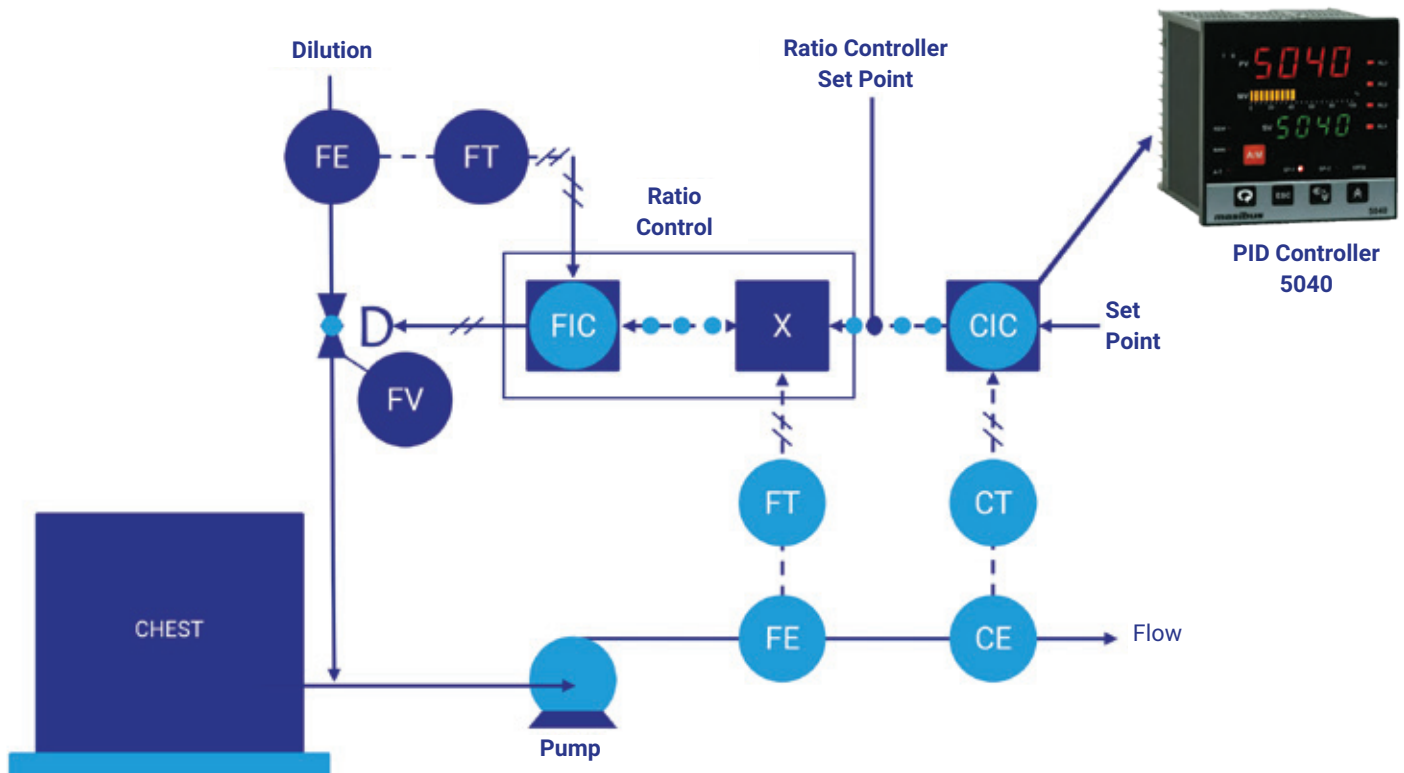


Boiler Suction Control- Power Plant








5040 Single Loop PID Controller Applications

Cascade Control

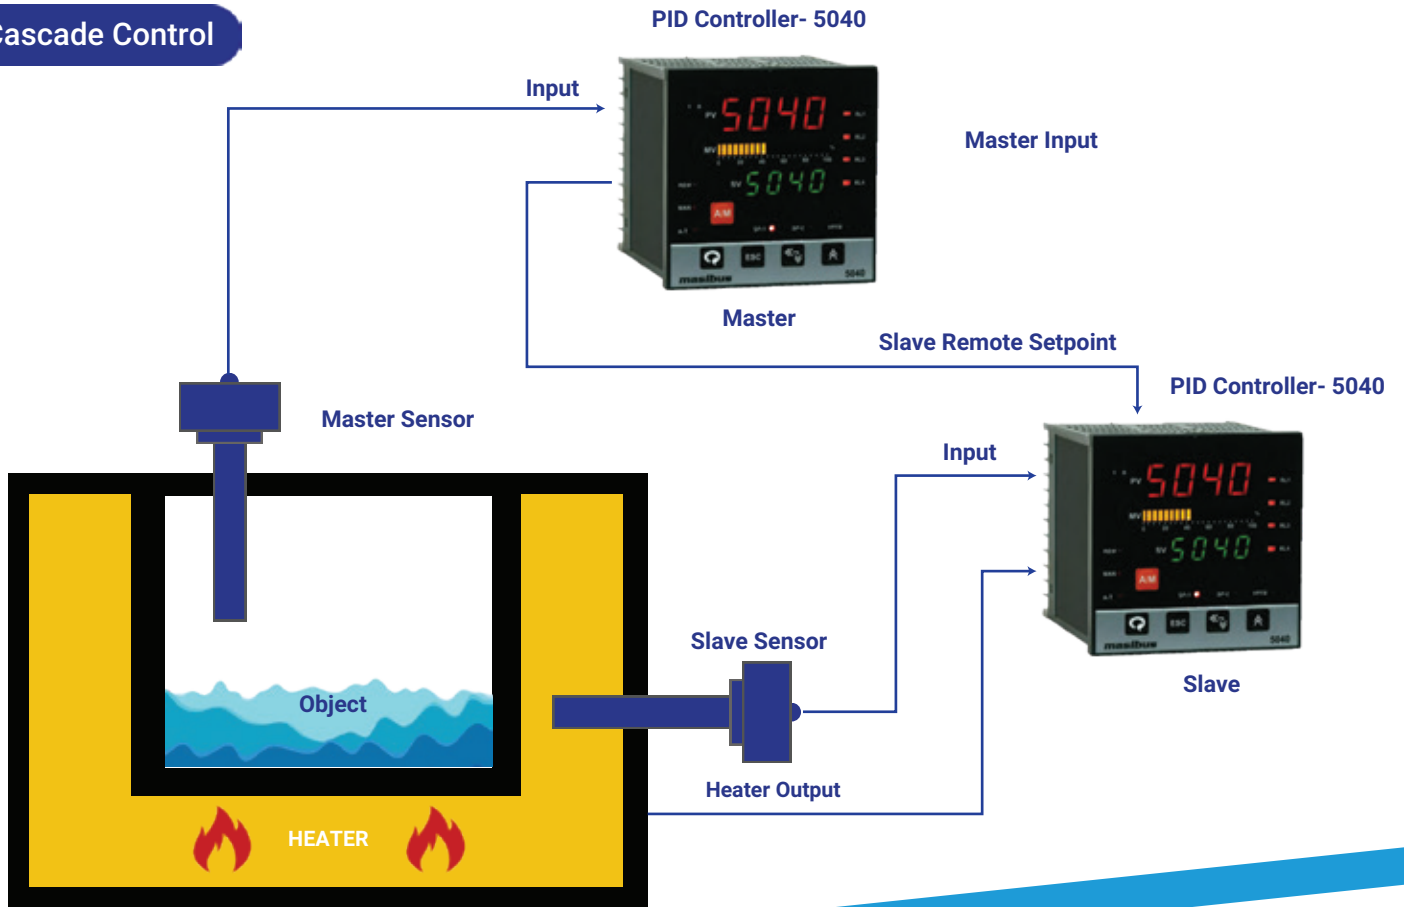

Ratio Control

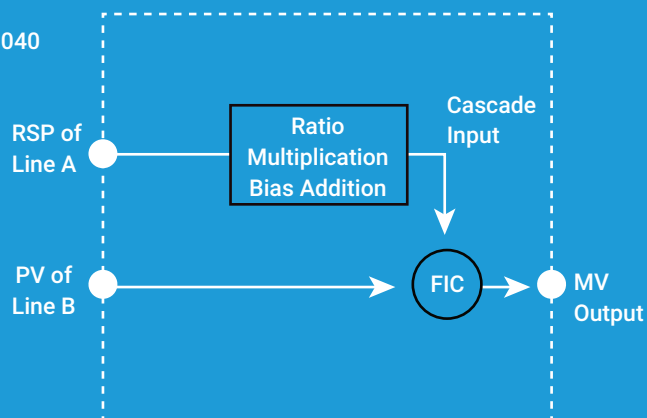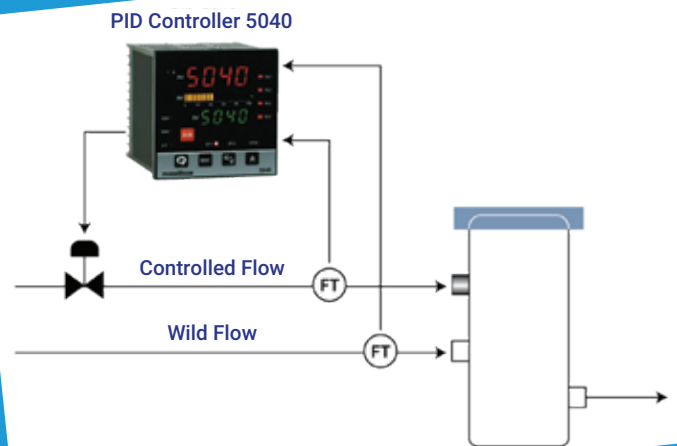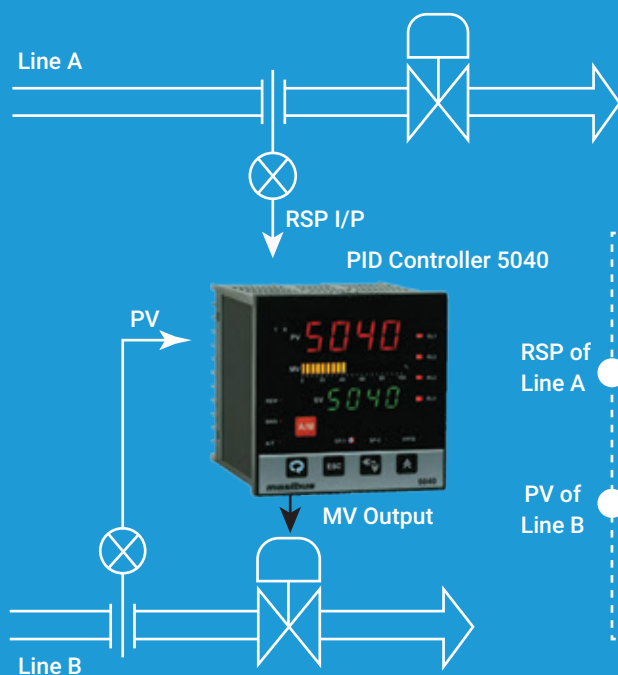



PID & ON/OFF Controllers

LC5296-XP-AT/ LC5296-XP-DC- Flame Proof PID & Dual Channel ON/OFF Controller



LC5296-XP-DC

LC5296-XP-AT

- CMRI and CCOE certifications complies to all statutory requirements of hazardous locations group IIA, IIB & IIC
- Touch sensitive keys operation and programming
 - Dual compartment option for Re-transmission (Field Prog.) and/or RS-485 add-on options
- 2 x Isolated Retransmission- Saves additional signal isolator requirement
- TPS with current limit- Saves external TPS, provides isolation and protection
- The configuration meets all ON/OFF and PID applications in hazardous areas
- Multitude of alarm types meets most critical applications

5002U-P ON/OFF Controller

- Simple user interface- Preferred in processes like heat treatment, ideal for metal treatment applications
- Fail safe: Protects process in case of failure
- Four relay for control and alarm, Re-transmission and RS-485 comm. to interface PLC/DCS and remote monitoring system
- Field proven in harsh environments
- Up to 4 independent programmable relay output



5002U-P

PID and ON/OFF Controller- 5006RN | TC5396 | TC548E



5006-RN



TC5396




TC548E

- Advanced, Efficient & Economical PID Controller
 - Large and bright display
- 4 Relay/2 relay/SSR output for control / alarm / trip
 - Retransmission field programmable and/or RS-485 add-on options
- 2 X Isolated Re-transmission (Optional)
- Saves additional signal isolator requirement
 - TPS with current limit
- Features, options and configurability meets 80% of PID applications
 - Highest performance / price ratio




TC5396 PID and ON/OFF Controller Applications

Temperature Control for Seal Heating Parts in Wrapping Machinery

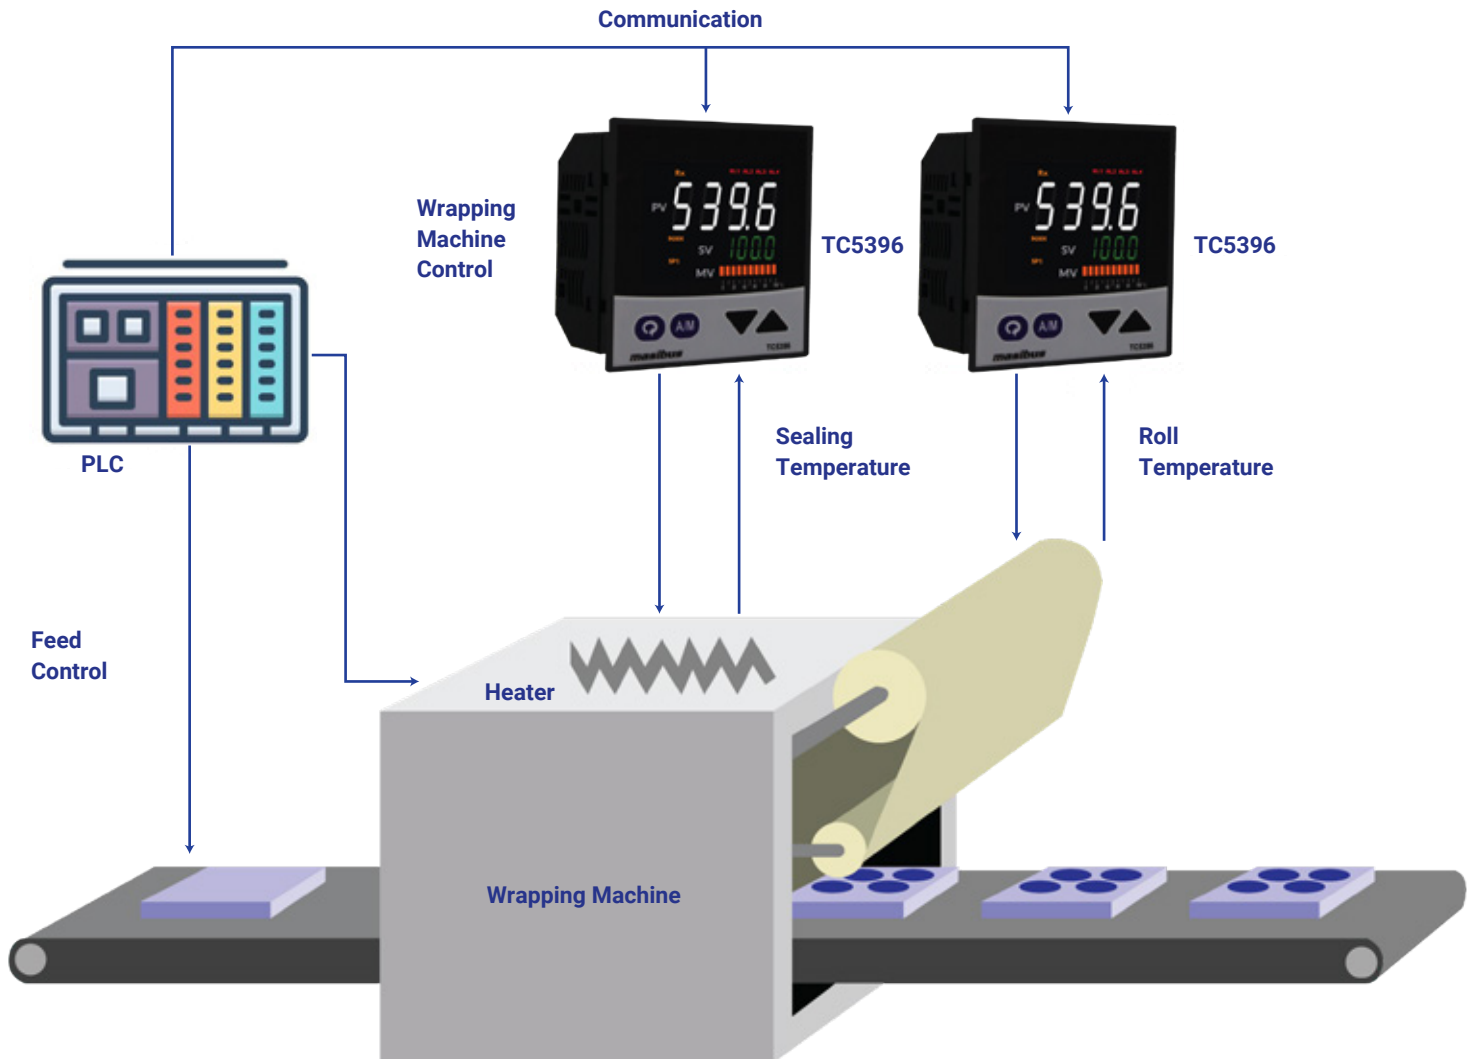

Furnace Monitoring

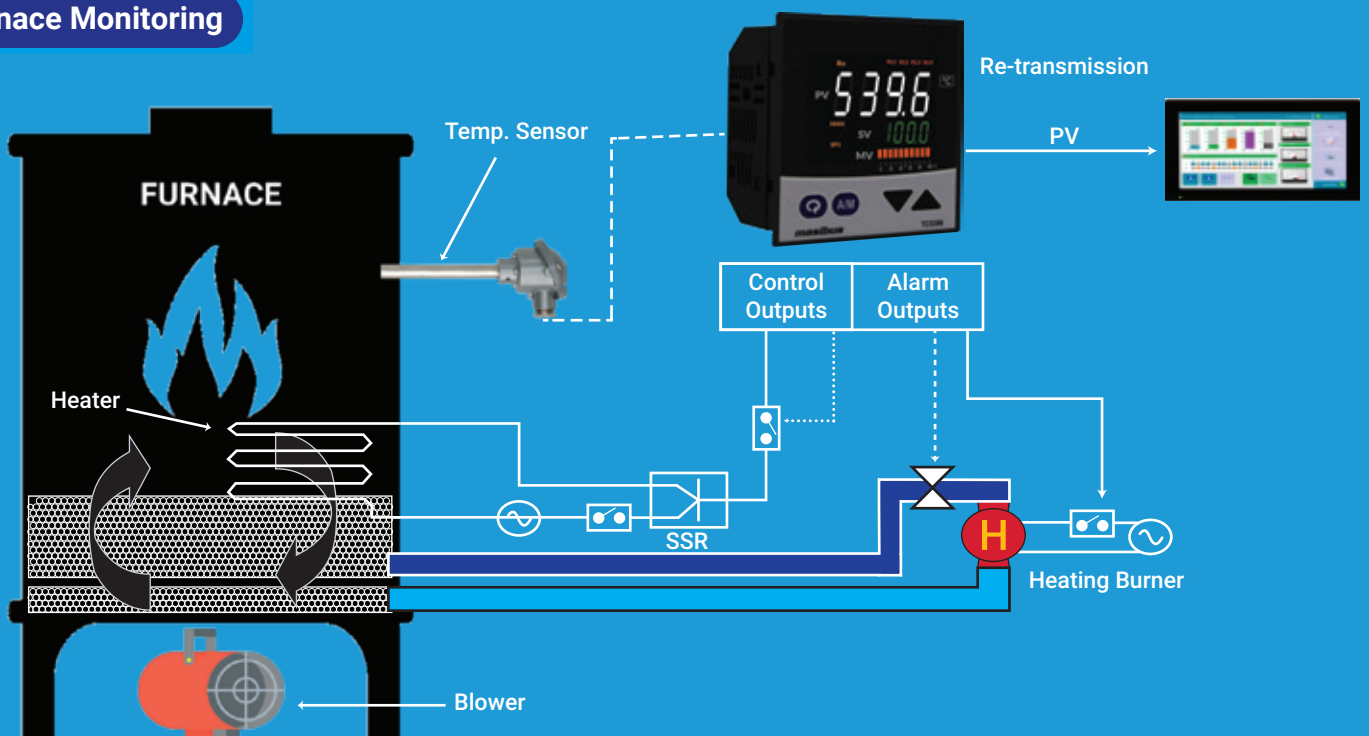



TC548 & TC548E PID and ON/OFF Controller Applications

PID Controller Extruder Machine Applications




TC548E
PID-ON/OFF Controller

Belling / Socketing Machine / Cutting Sealing Machine



TC548E
PID-ON/OFF Controller

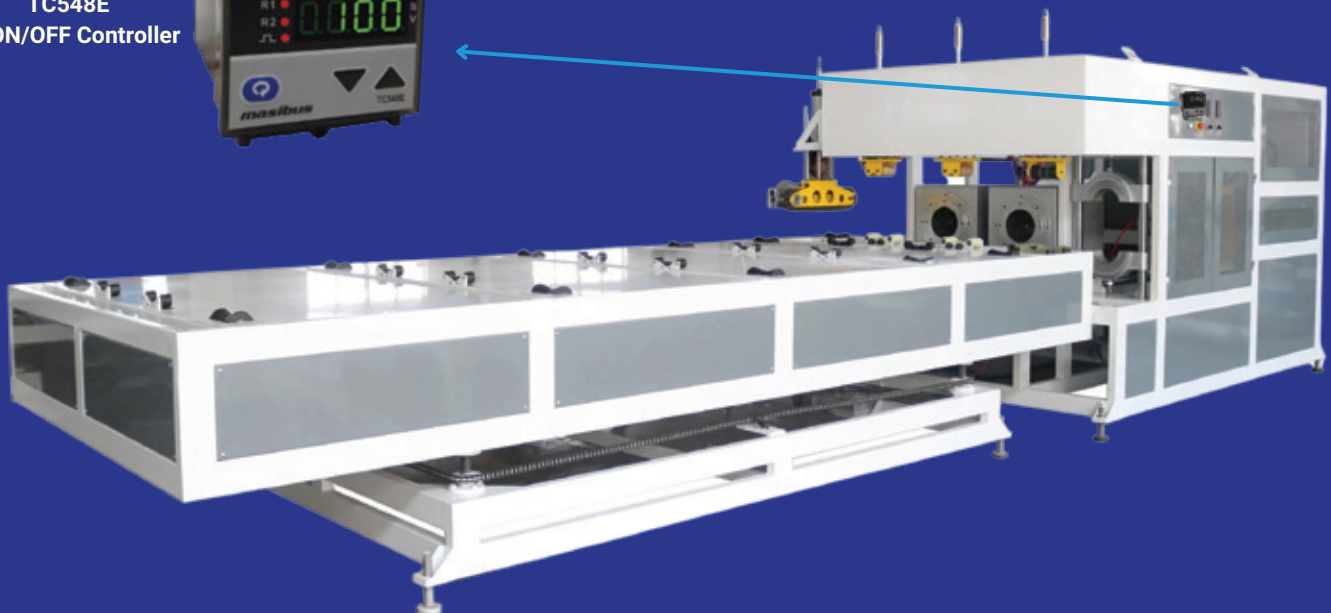



Controller Applications

Furnace Temperature Controller




5002U-P



Sealed Quench Furnace

Compressor Coolant Temperature Controller

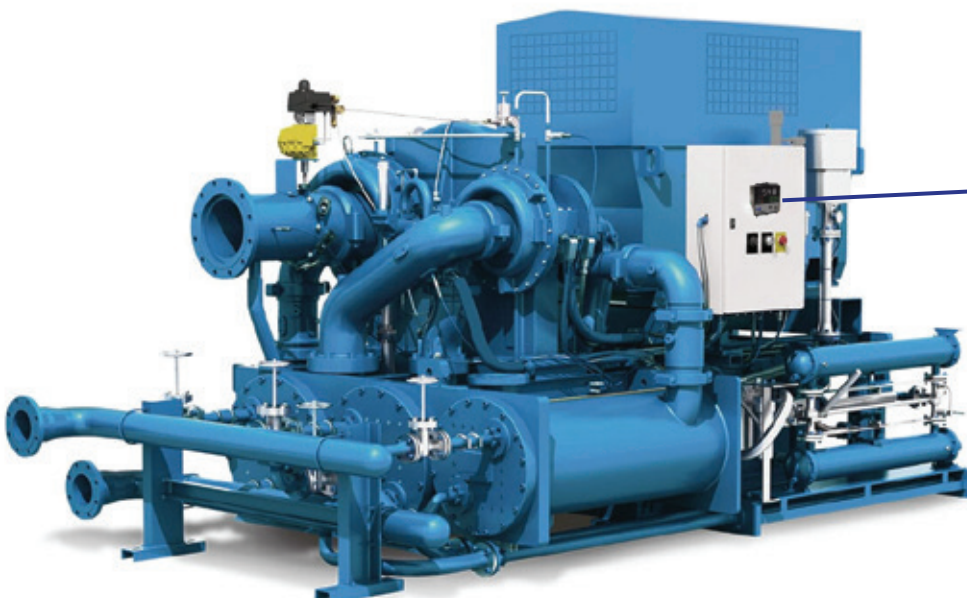

TC548E
PID-ON/OFF Controller




Overview of Indicator Offerings

What is a Digital Panel Indicator

Digital panel indicator receives the measurement signal as Input in the form of Voltage / Current / RT / TC / Humidity / Pressure / Flow Rate / Level / Load Cell / pH / Pulses / mV etc., process it and displays after necessary scaling/linearization which is configurable from keypad / touch-pad.

They can also act as interfaces by performing operations such as comparisons with user-set values, and transmitting data to computers / PLC / DCS.

Masibus Indicators are easy to use and have good visibility in the field with wide variety of display size 0.3" / 0.56" / 2" / 4" / 6" and no. of digits 4 / 5 / 6.

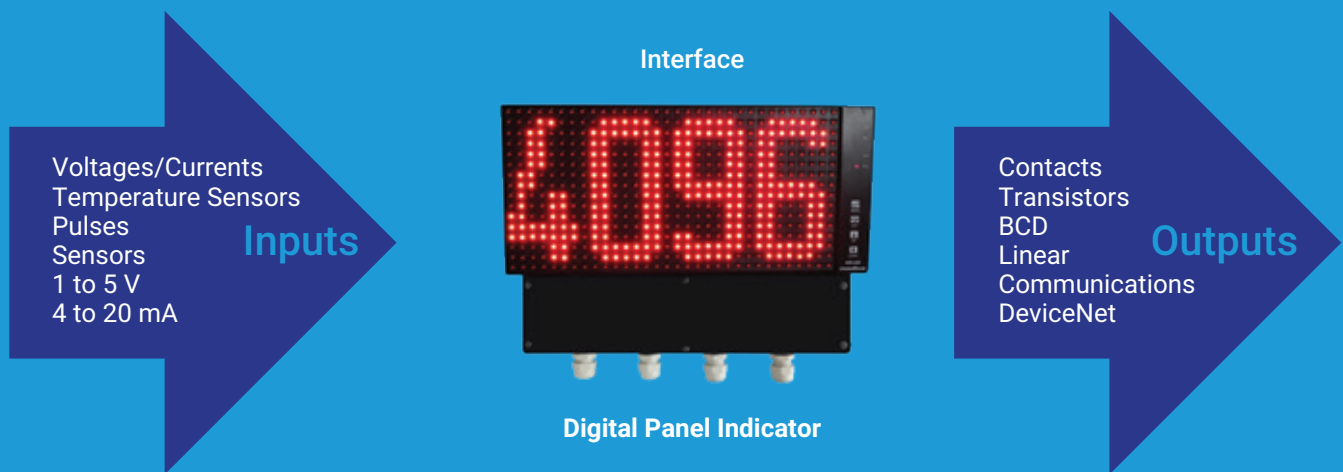


Indicator with Alarm and Trip

Indicator monitors a process signal (such as one representing temperature, pressure, level or flow) and compares it against a preset limit. If the process signal moves to an undesirable high or low condition, the alarm activates a relay output which could be utilized for alarm declaration, maintain a normal & safe operation.

In all our Indicators we have separate relay output for alarm and trip condition.

Once a signal crosses the alarm condition, alarm relay gets activated. On reaching trip condition, trip relay gets activated. Both output could be latched by the initial configuration of the indicators (For selected models).

The latching could be made reset by acknowledgment.

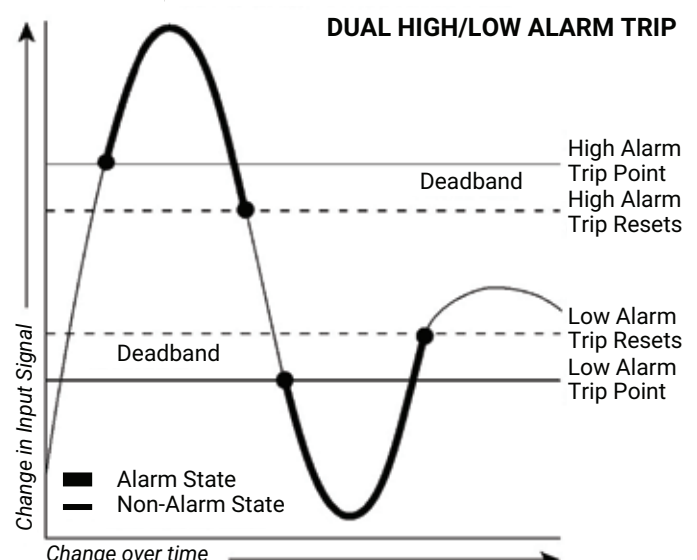



Indicators Offerings



PHI-22-XP



409-W



40005E



409-6IN



LC5296H



1008S



406



LPI-1-XP



CDU



LPI-1-LED



Display: Enhanced visibility, 6" bright display suitable for outdoor application

Accuracy: High accuracy with up to 5 digit option



TPS: Inbuilt power supply for transmitter, saves external power supply

Communication: Isolated Re-transmission & RS-485 Modbus communication



Configurable: Input & output signal type is configurable, helps reduce inventory



Technical Specifications- Indicators

		409-4IN	409-6IN	LPI-1-LED	LPI-1-XP	LC5296H	406
							
Mounting		Rack / Panel / Wall	Wall	Panel/ Wall	Wall / Pipe	Panel	Panel
Panel Cut Out (HXW)		444 (+0.8) x175 (+0.8)	-	-	-	45 x 92	45 x 92
Dimension (HXWXD)		IP 20: 440 x 175 x 70 IP 65: 500 x 300 x120	405 x 250 x 90 (With Clamp)	Panel: 96 x 48 x 68 mm Wall: 122 x 88 x44 mm	112 x 115 x146	48 x 96 x 85	48 x 96 x 85
Display Range		-1999 to 9999	-1999 to 9999	-1999 to 9999	-1999 to 9999	-1999 to 9999	-1999 to 9999
Character Height		4"	6"	0.56"	0.56"	0.56" / 0.8"	0.56"
Accuracy		±0.1% of FS ± 1digit	±0.1% of FS ± 1digit	±0.1% of FS ± 1digit	±0.1% of FS ± 1digit	TC, RTD : ±0.25% of FS ± 1° C Current, Voltage : ±0.1% of FS ± 1 digit	TC, RTD : ±0.25% of FS ± 1° C Current, Voltage : ±0.1% of FS ± 1digit
Input		Thermocouple (E, J, K, T, B, R, S), RTD (Pt100), Current, Voltage, Resistance	Thermocouple (E, J, K, T, B, R, S), RTD (Pt100), Current, Voltage, Resistance	4-20mA	4-20mA	Thermocouple (J, K, T, R, S), RTD (Pt100), Current, Voltage	Thermocouple (J, K, T, R, S), RTD (Pt100), Current, Voltage
Output	Serial Input	●	●	-	-	X	-
	DI	X	X	X	X	X	X
	Re-transmission Output	1	1	-	-	1	X
	Alarm	2	2	-	-	2	X
	LPS	●	●	-	-	●	●
Communication	RS-485	●	●	-	-	●	X
Power Supply	85-265VAC / 100-300 VDC	●	●	-	-	●	●
	18-36 VDC	-	-	-	-	●	●
	Loop Powered	-	-	●	●	-	-

* For more details, refer Product Catalogue



pH Indicator & Load Cell Indicator

PHI-22-XP Flame Proof pH Indicator



- 5 Point calibration
- Slope/offset adjustment
- Built-in-diagnostics
- Electrode performance indicator
- Auto/manual temperature compensation
- Certified for use in zone 1 of gas group I, IIA & IIB hazardous areas, optionally IIC certified compact flame proof housing
- Re-transmission signal and RS-485 can be opted for interfacing with PLC/ SCADA/ Recorder etc.

Large Display Indicators



- 409-6IN: High brightness for outdoor application
- Measure 21 Selectable input types (TC, RTD, mV, mA, V, Ω)
- Programmable Re-transmission output (Optional)
- Two programmable alarm outputs (Optional)
- Serial RS-485 Input (Modbus Slave Read/Write)
- PV write facility via serial input
- Transmitter power supply
- RS-485 serial communication (Optional)
- 409-4IN: 4" (100mm) Large Red LED Display

Digital Peak Hold Temperature Indicator

Forging Industry



Billet Heating Furnace



Pyrometer



4-20mA

Relay
Accept/Reject Billet

HMI



RS-485



409-4IN



Process Indicators

LPI-1 / LPI -1- XP -Loop Power Indicator & Ex - Proof Loop Powered Indicators



LPI-1



LPI-1

- 4-Digit LED Display
- Accuracy 0.1% of FS
- Loop powered with low Voltage Drop
- Reverse Scaling for indication range
- Square root extraction
- Easy Configuration with pushbuttons
- Compact and IP65 Front/Housing
- Panel and wall mount or pipe mount for FLP Version



LPI-1 XP

LC5296H / 408-M / 406L- Process Indicator (Relay Optional) & 40005E Bar Graph indicator



- Retransmission (Field Programmable) and/or RS-485 add-on options
 - One model for many applications, interface with PLC, SCADA, IIoT and other platforms
- Two relay output option
 - For alarm and ON/OFF control
- TPS with current limit
 - Inbuilt power supply for transmitter, saves external power supply
- Input High/Low Programmable
 - Settable input signal from 0 to 20mA/0 to 10V DC to connect non std. output type sensor



Flow Rate Indicator & Totalizer

1008S/1006H Flow Rate Indicator & Totalizer | 1008S-XP:- Ex-Proof Flow Rate Indicator & Totalizer



1008S-XP




1006H



1008S

- Accurate, Pressure & Temperature compensation, fast sampling and totalize with precision even fast changing flow rates
- 4 Relay output - 2 Relay for flow rate alarm & 2 relay for pre/final batch total
- 4-Digital I/P- Batch start/stop, batch / integration total zero
- Mass flow measurement with additional Pressure and Temperature I/P
- Gas/ liquid flow measurement- Superheated steam flow measurement & Saturated steam flow measurement
- Five segment linearization on flow Input for nonlinear type of input
- Retransmission output easy interface with PLC / DCS / SCADA systems
 - Ex-Proof enclosure, touch sensitive keys operation, full operation and programmable without opening in a compact size

Mass Flow Measurement

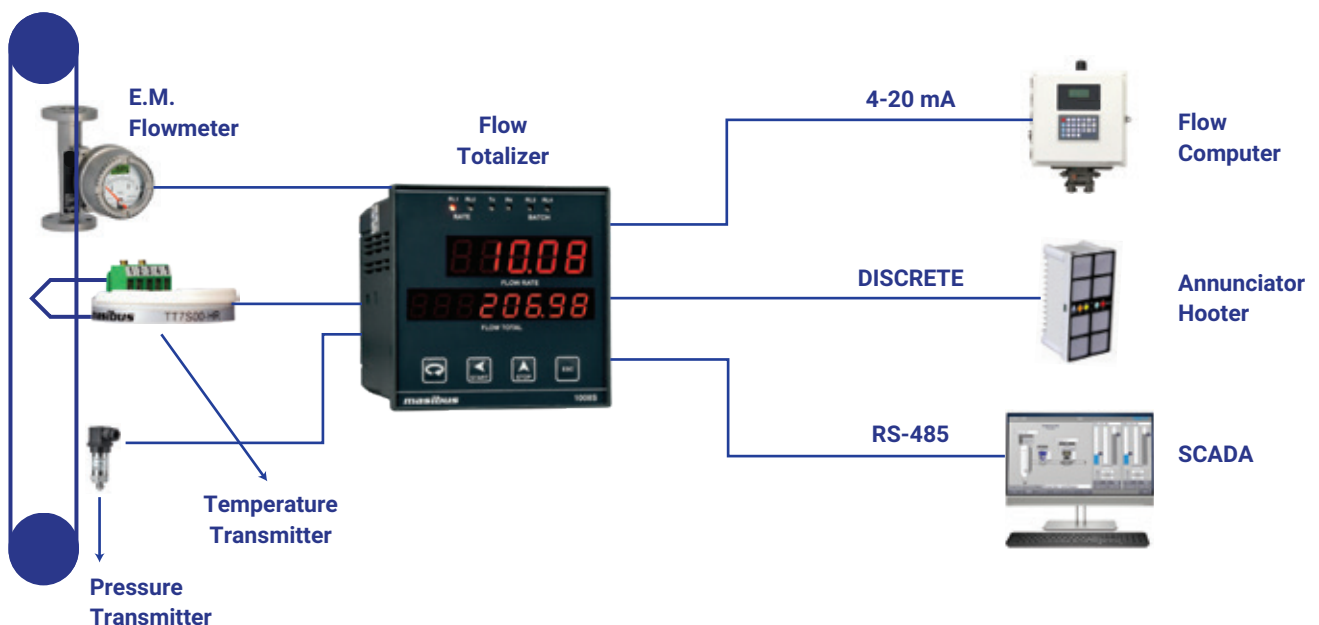




Clean Room Indicator & Filter Display Unit

Clean Room Display Unit



- Variant for combination of Temperature, Humidity and DP Indication
- Variant of internal sensor, external sensor, wireless sensor, analog sensor
- Backed by Masibus 21CFR Software with Auto Backfilling via DNP 3.0 avoiding data loss
- 3.5" TFT touchscreen LCD variant
- Soft Input for AHU status
- Digital input for door open/close
- Ex-Proof enclosure- Touch sensitive keys operation

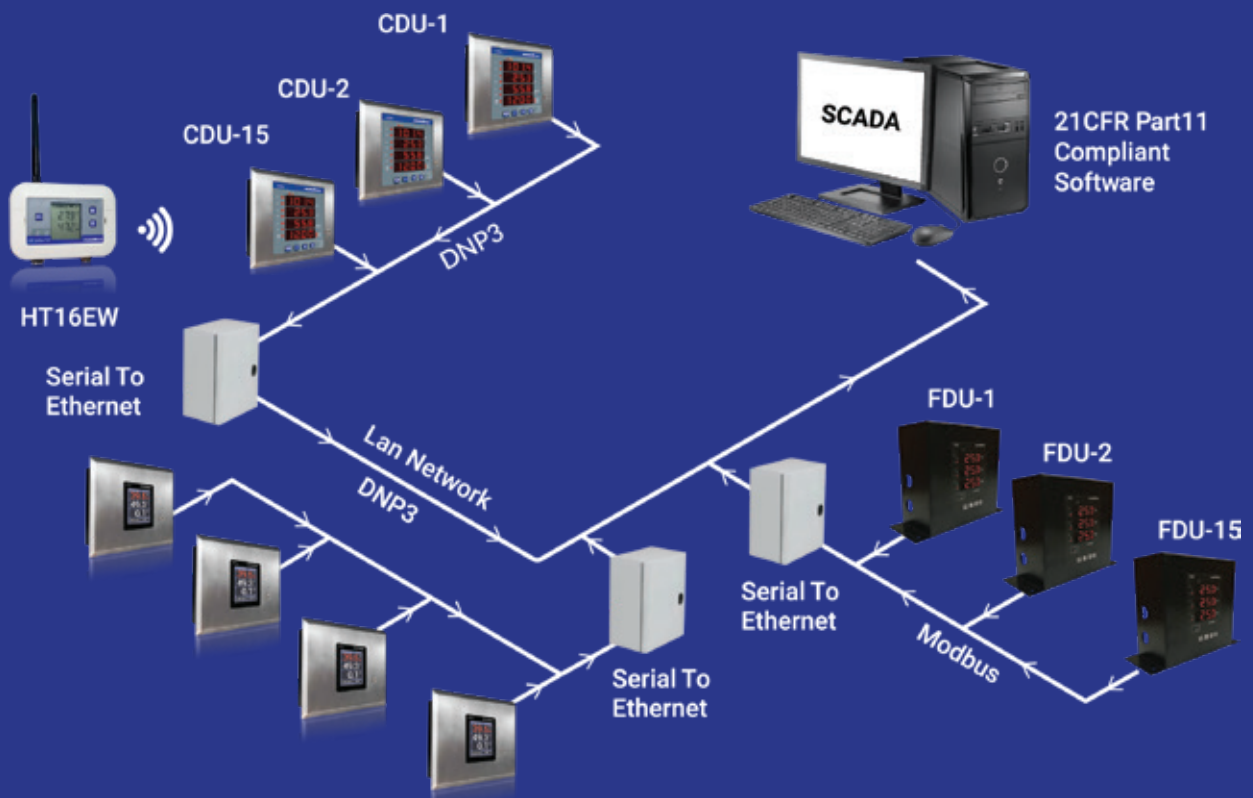

Sonepar India Pvt. Ltd.

Gandhinagar

Address: B-30, G.I.D.C. Electronic Estate,
Sector - 25, Gandhinagar - 382 016,
Gujarat, India

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9662042824

Goa

Address: C-6, Phase 1-A, Verna Industrial
Estate, Verna, Salcette - 403722,
Goa, India

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9822135796

Pune

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9689937234

Bengaluru

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 8732971943

Chennai

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9725154195

Delhi

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9909949742

Hyderabad

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9909949062

Kolkata

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9512003359

Mumbai

E-mail: sales.masibus@soneparindia.com

Ph. No.: +91 9689937234

Gurgaon

Address: Plot No. 229/239, Village -
Kherki Daula, Sector 76, Gurugram,
Haryana, 122004, India

Kolkata

Address: 503, Block 4B, Ecospace
Business Park, Newtown, Rajarhat,
Kolkata, West Bengal, 700160, India

Chennai

Address: Plot No. 1, Gokul Garden,
Melnallathur, Thiruvallur, Chennai,
Tamil Nadu, 602002, India

Aurangabad

Address: FP-42, Five Star Industrial Area,
Shendra MIDC, Aurangabad,
Maharashtra, 431201, India

Panchkula

Address: Plot No. 263, Industrial Area,
Phase-II, Panchkula, Haryana,
134113, India

Bhubaneswar

Address: Plot No. 443, 1st Floor,
Saheed Nagar, Bhubaneswar,
Odisha, 751007, India

Website: www.soneparindia.com

Website: www.masibus.com

E-mail: sales.masibus@soneparindia.com

Masibus Automation & Instrumentation FZC

Sharjah

Address: A2-102, SAIF Zone, PO Box
120145 Sharjah, UAE

E-mail: sharjahall@masibus.com

Ph. No.: +971 65574650